ALLEN&HEATH




WARNING — HIGH VOLTAGES


Power Supply Unit (PSU) work should only be carried out by qualified personnel.


We recommend that you use an approved Allen & Heath service centre for all power supply work.


Please contact your local Allen & Heath distributor for more details.


http://www.allen-heath.com/

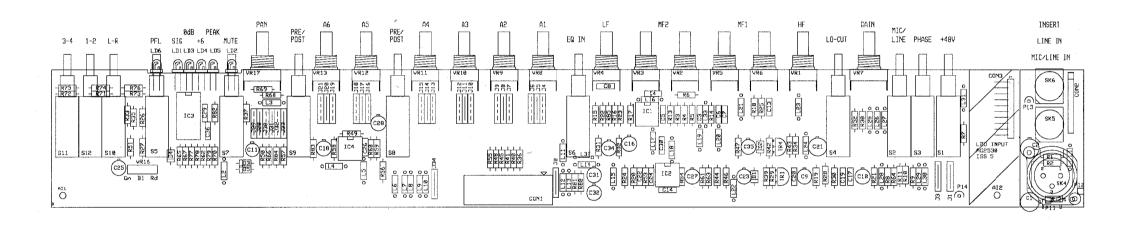


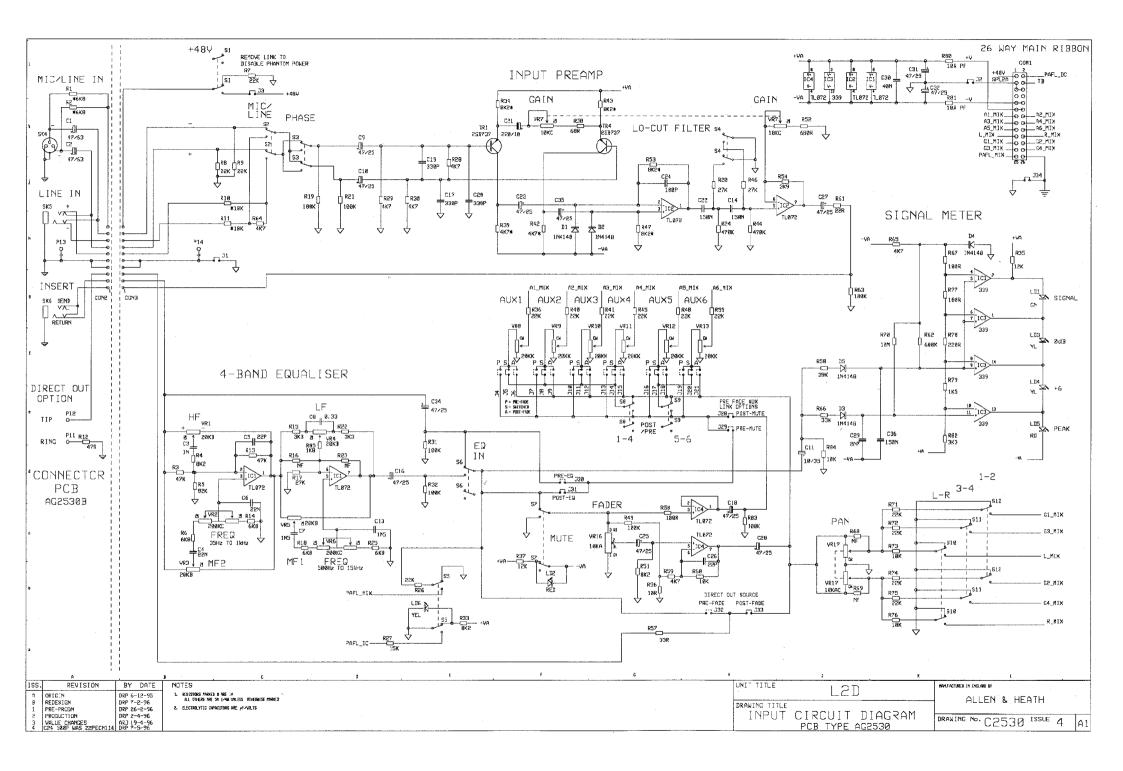

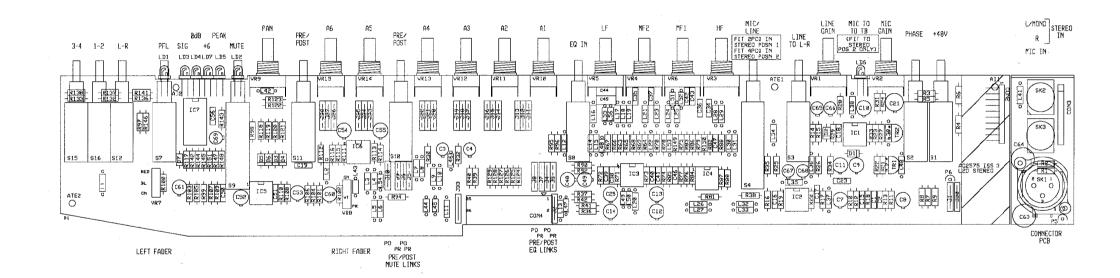

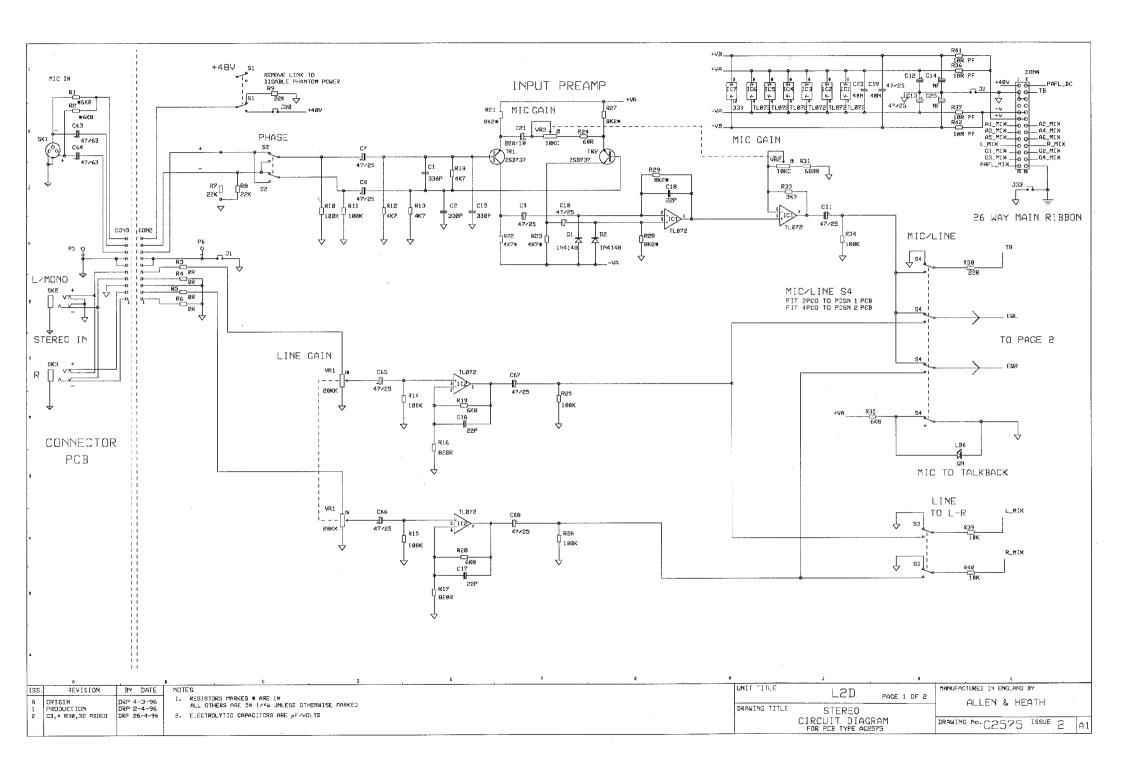

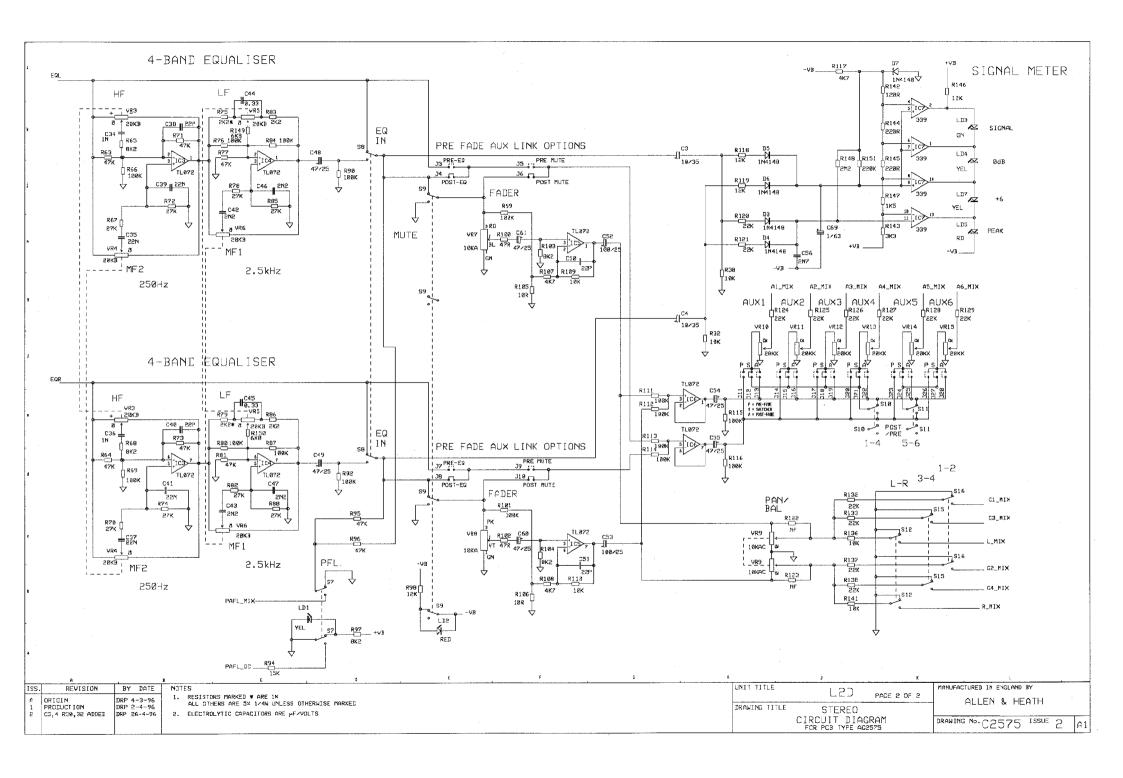


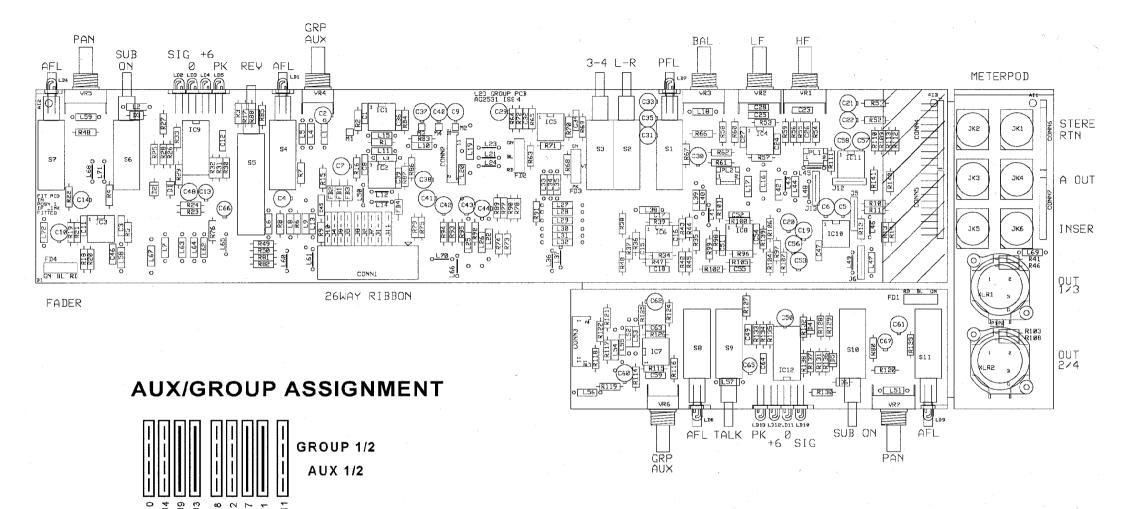



GROUP 3/4


AUX 3/4


LINK L44 REPLACED WITH 47/25 ELECTROLYTIC CAPACITOR ORIENTATED THE SAME WAY AS C6 & C20.

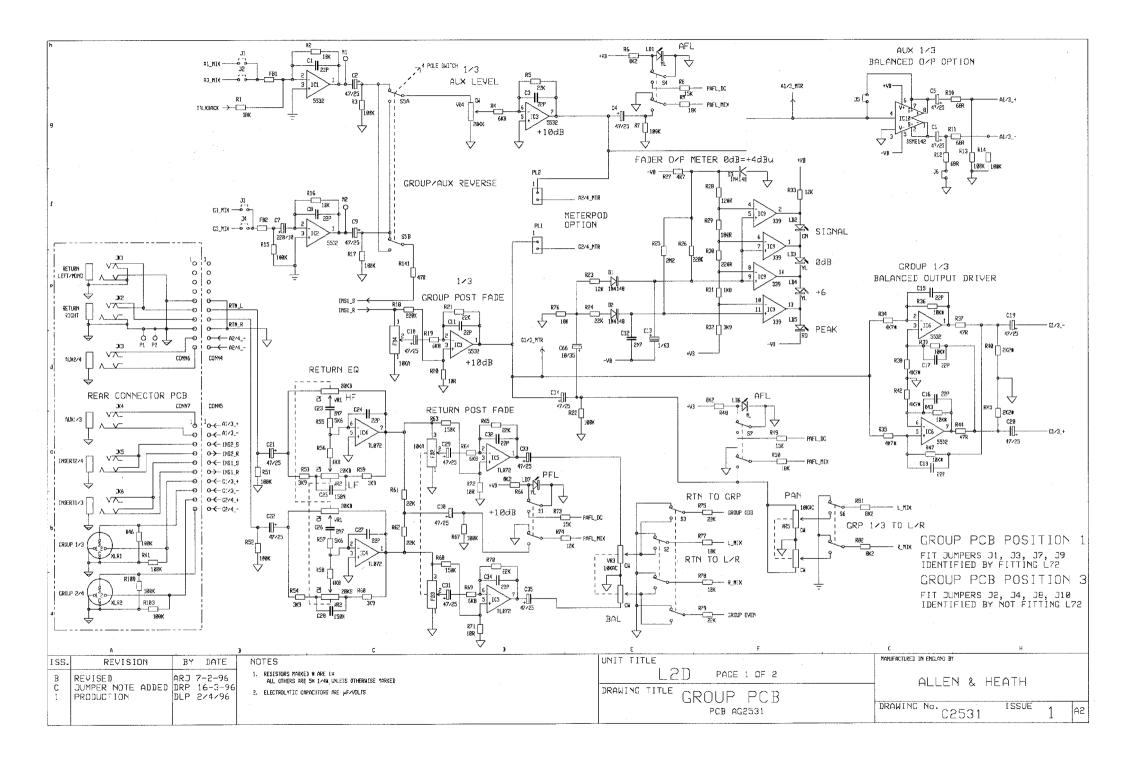


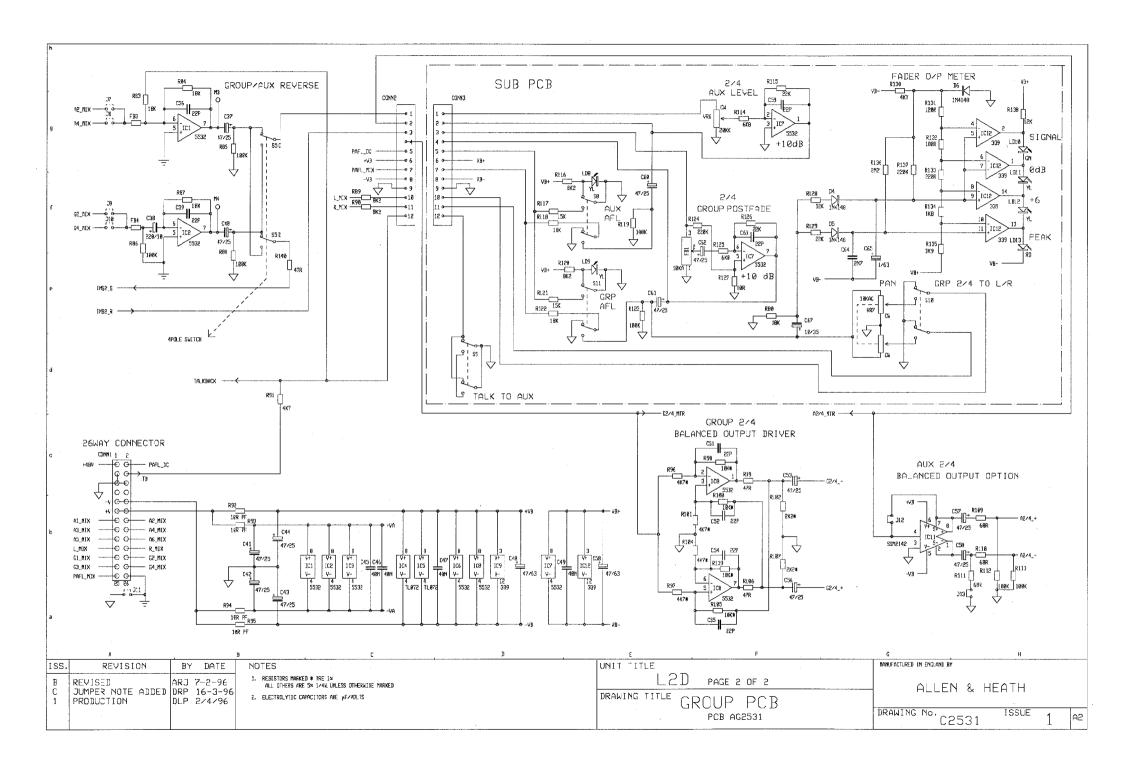


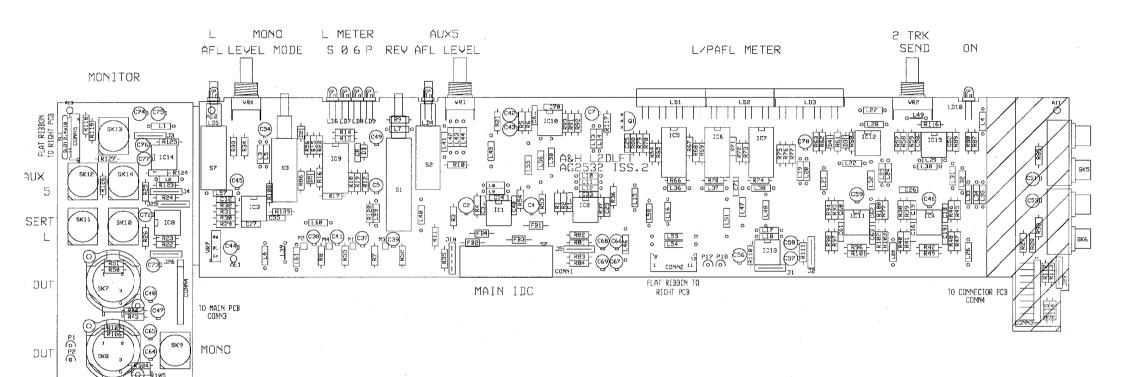


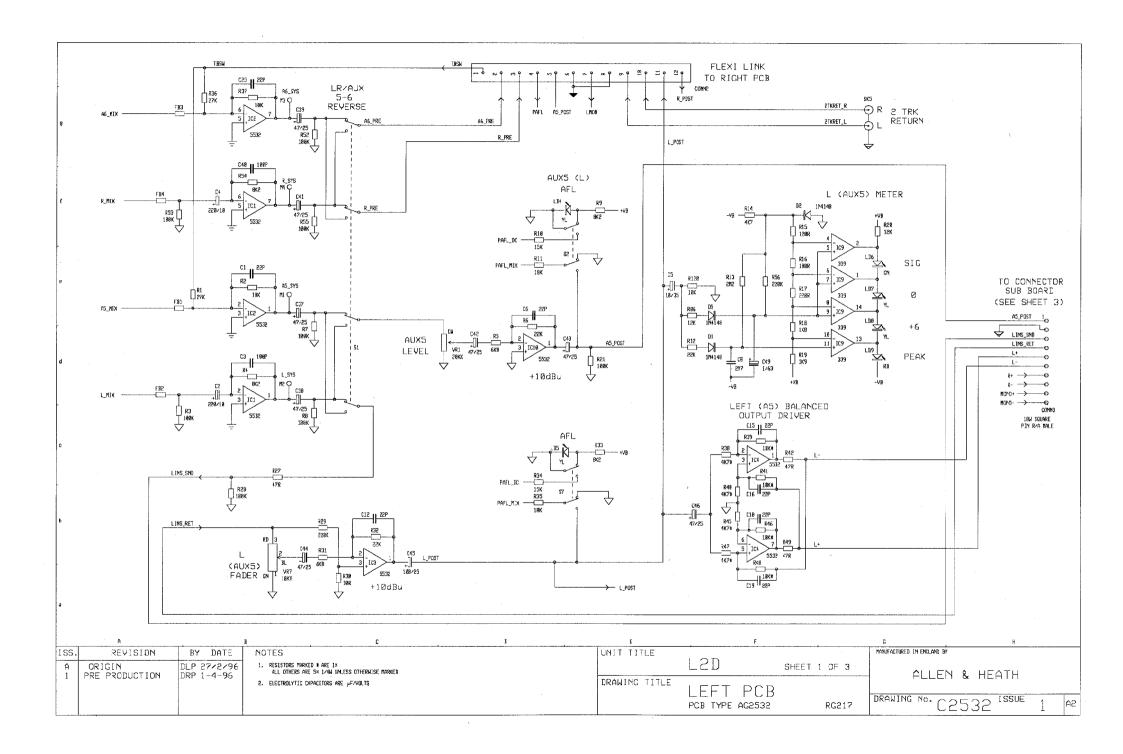


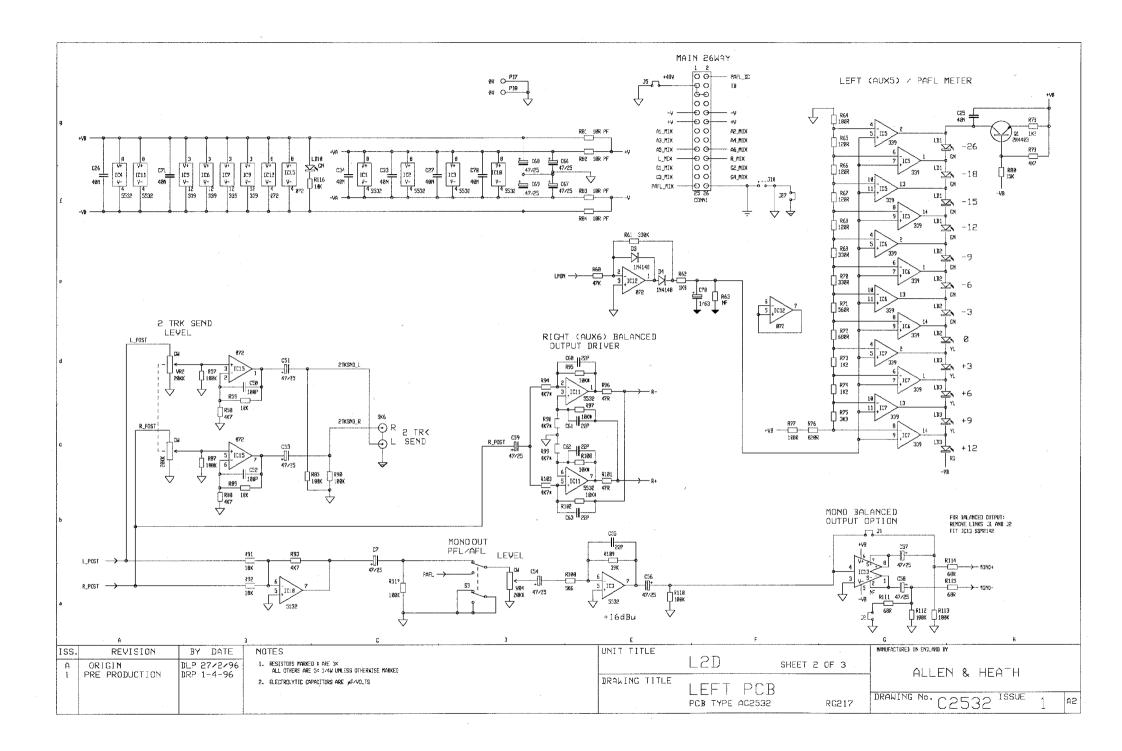

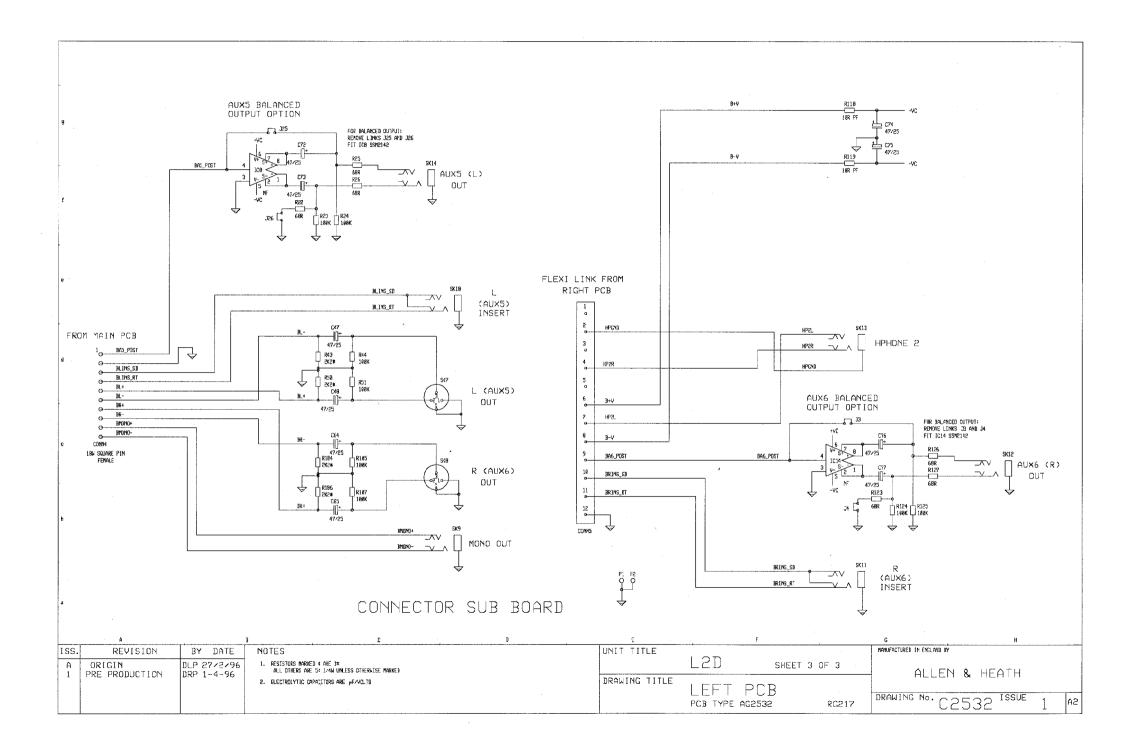

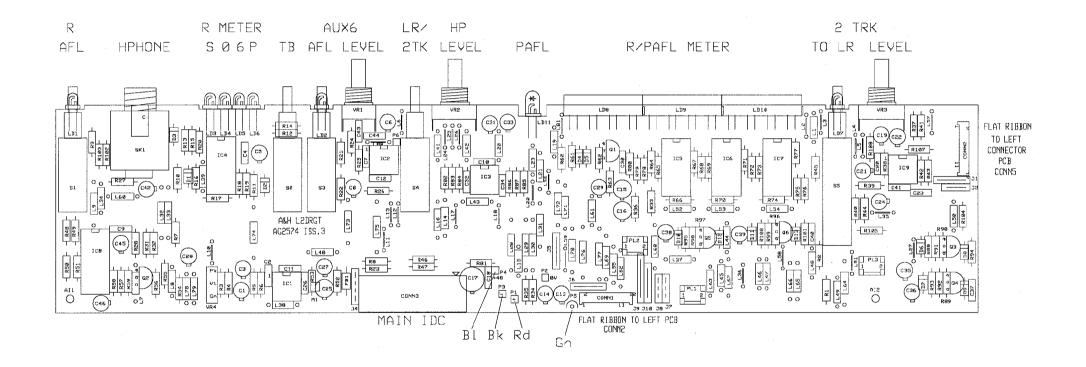

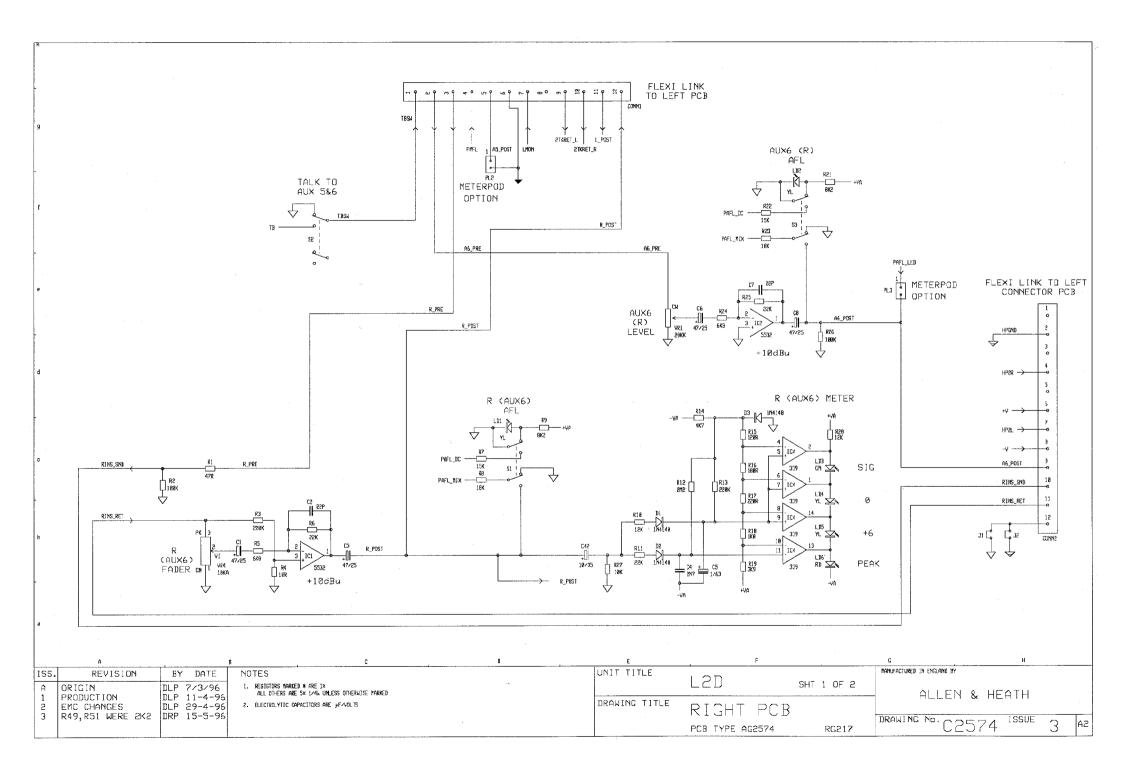

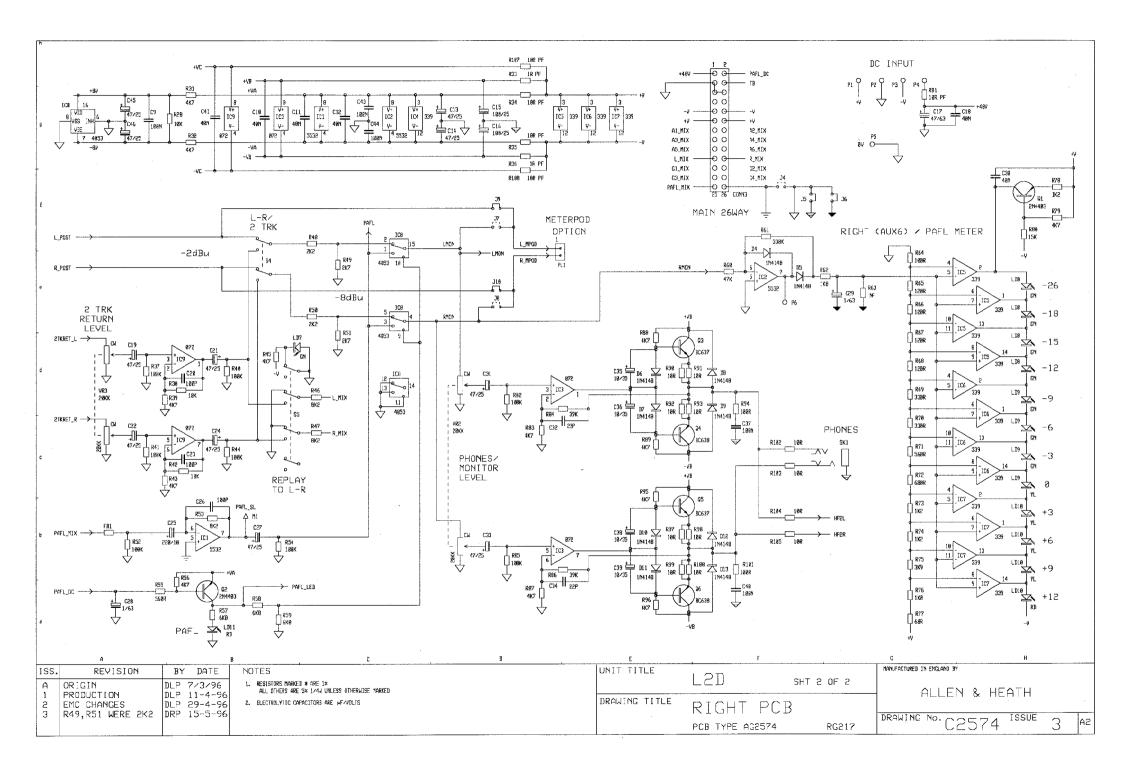

SECTION C



POWER SUPPLY

CAUTION!

TO AVOID DAMAGE TO INTERNAL COMPONENTS BY MISHANDLING AND/OR MISCONNECTION, ONLY TECHNICALLY COMPETENT PERSONNEL SHOULD ATTEMPT SERVICE WORK ON THIS UNIT.

ANY SERVICE WORK SHOULD BE UNDERTAKEN ONLY AFTER DISCONNECTING THE MAINS SUPPLY LEAD FROM THE POWER SUPPLY UNIT.

TECHNICAL DESCRIPTION

The power supply for the *GL2000* range is internal to the console and is mounted on a steel sub-chassis.

INSTALLATION

An important consideration when positioning the console is the need for natural convection of air flow over the whole unit. Good ventilation, in the floor and back of the console, will ensure a path for continuous air flow. Pay particular attention to the ventilation around the power supply unit which is mounted off the rear connector panel. The *GL2000* can be operated as a free standing unit without requiring any special cooling arrangement, but should not be covered in any way. Always stand the unit on a firm flat surface well away from any soft furnishings.

THE POWER SUPPLY AND CONSOLE EARTHING

The *GL2000* power supply is a linear power supply which, like other linear supplies, produces DC voltages by rectifying, smoothing and regulating AC voltages from the secondary windings of a mains transformer. The console connects directly to the local AC mains supply and provides the regulated DC operating voltages required by the *GL2000* console. The console chassis is always connected to mains earth. Audio 0V connects to the console chassis internally. Should problems be encountered with ground loops operate the audio ground lift switches on other equipment connected to the console or disconnect the cable screens at one end. Refer to the section on 'EARTHING' in the User Guide. This is to avoid earth loops in situations where multiple earth paths are present.

THE CHASSIS METALWORK IS ALWAYS CONNECTED TO MAINS EARTH VIA THE EARTH WIRE IN THE MAINS PLUG. DO NOT REMOVE THE EARTH WIRE CONNECTION IN THE MAINS PLUG!

CONNECTING AC MAINS TO THE CONSOLE

Mains input to the *GL2000* is via a standard 3 pin IEC mains input connector. A mains cable with moulded mains plug suitable for the local supply is supplied.



Check that the voltage indicated in the fuseholder window is the same as the mains supply in your area.



AC mains supply = 100 to 110 V.AC

100

20mm fuse

AC mains supply = 110 to 125 V.AC

120 T 1.6A

T 1.6A

20mm fuse

AC mains supply = 210 to 230 V.AC

230

T 630mA 20mm fuse

AC mains supply = 235 to 260 V.AC

240

T 630mA 20mm fuse



To avoid the risk of fire replace the fuse only with the correct type and value as specified on the unit.



Always switch the unit off before connecting or disconnecting the console power cable.

SPECIFICATION

AC MAINS INPUT: 100V, 110V, 120V, 220V, 230V or 240V @ 50Hz to 60Hz single phase

POWER CONSUMPTION: 60VA

DC OUTPUT: +48V @ 100mA, +/- 16V @ 0.8A per rail. (GL2000-424)

NOISE & RIPPLE: < 2mV max (peak to peak)

SERVICE ACCESS

Any fault condition, with the exception of simple mains fuse failure due to underrating or an unusual mains input condition, will require removal of the base cover to enable correction of the fault. This is achieved using a cross-head screwdriver to remove all of the base screws which are positioned along the edges of the base. Do not forget to remove the two screws in the centre rear of the base.


Carefully lift the cover and place it to one side. The power supply sub chassis can then be removed by unsrewing the 2 mounting screws (A) in the console rear panel and the 2 fixing screws (B) in the sub chassis base next to the PSU circuit board. Take care not stretch the wires connected to the console.


Servicing Components

All of the regulators are in TO220 packages. To replace them, it will be necessary to remove the power supply circuit board assembly with the heatsink attached. Refer to the L2D PSU assembly diagram 002-150.

- 1.) Remove the 4 PCB mounting nuts (C) and 2 heatsink fixings (D).
- 2.) Carefully lift the heatsink and PCB assembly clear of the PSU sub chassis and unscrew the screw and nut of the regulator IC that requires replacing. Take care to retain the small insulating bush beneath the head of the screw and the insulating SIL pad under the regulator.
- 3.) Rotate the assembly to gain access to the solder side of the PCB and desolder the three terminals attached to the regulator. The regulator can now be removed.
- 4.) Fit the replacement regulator by first fixing it to the heatsink using the screw and nut and then soldering the three terminals to the circuit board. Make sure the insulating SIL pad and bush are fitted. The metal tab at the top of the package is electrically connected to the centre lead and correct insulation is essential. If the insulating SIL pad between the regulator and the heatsink looks damaged then it should be replaced before installing the new regulator. Note that the regulators rely on good thermal contact with the heatsink to dissipate heat, and this is provided by the SIL pad.
- 5.) Reassemble the circuit board and heatsink assembly into the power supply sub chassis. Check your work and remove any debris from the sub chassis before refitting it to the console.


CAREFULLY CHECK ALL WIRING CONNECTIONS AND ENSURE THAT THERE ARE NO LOOSE PARTS LYING AROUND INSIDE THE CONSOLE.

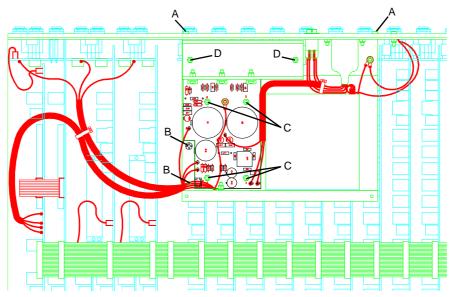


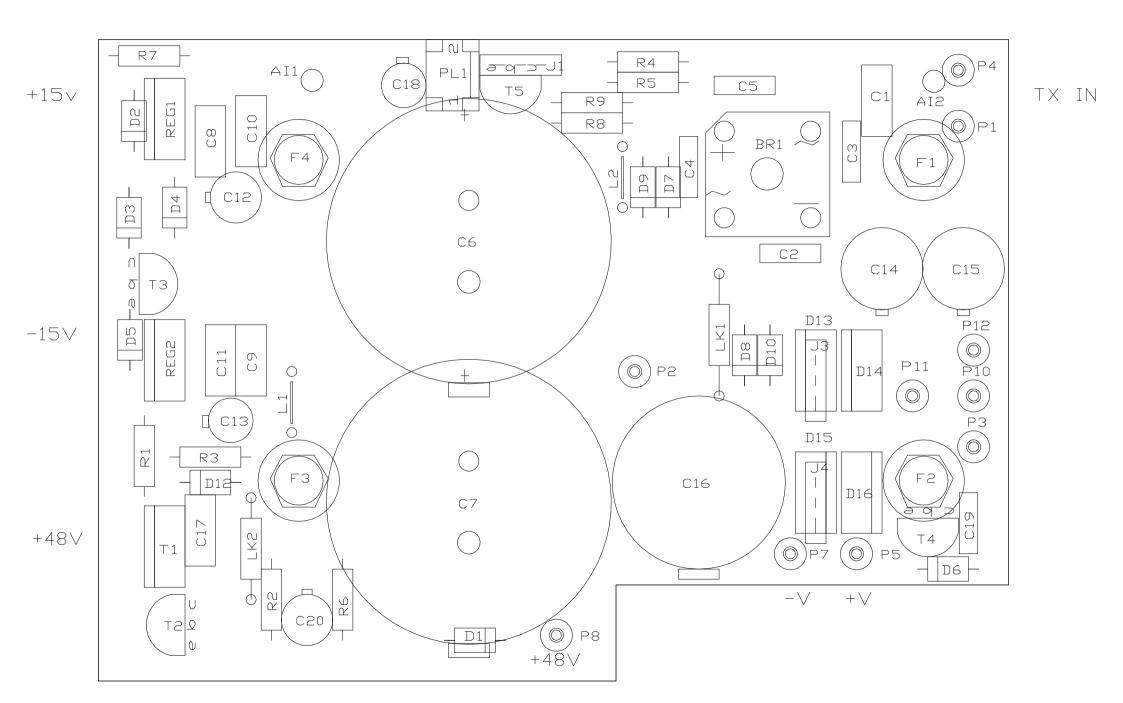

AG2552 ISS 6 LAYER 10 PEELABLE MASK

DANGER - HIGH VOLTAGE! DISCONNECT POWER BEFORE REMOVING POWER SUPPLY UNIT REFER SERVICE WORK TO QUALIFIED SERVICE PERSONNEL ONLY MAINS TRANSFORMER REFER TO DRAWING M2577 POWER INLET VOLTAGE SELECTOR 240 BROWN MAINS IEC AL0589 FUSE HOLDER AL0588 REG1 SGS7815 BR1 FUSE RATING DRANGE 0.1 C12 100-120V (T1.6A) 220 WHITE C6 D3 1N-1N4002 220-240V (T630mA) VIOLET CT 0 115 BLACK KBPC602 _C11 1N4002 T10000/35 100 GREY DRANGE 18 10/35 1N4002 REG2 SGS7915 Q BLUE GREEN/YELLDW AM2577 FAN SPEED CONTROL CIRCUIT 100/100 MAINS SWITCH 1N4002 1N4002 AL2047 4K7 C19 ////// MPSA92 BC556,_ BROWN C16 __ 150R BLUE C15||+ 1000/100 Sc:-E 100/100 □_{100K} ----0 +48V NF,USE OR 48VZENER 47/63 MAINS INPUT 50/60 Hz *NOTE*: C2, C3, C4, C5 ARE 100NF/100V MULTI-LAYER CERAMIC (AF2534) 60 VA MAX MANUFACTURED IN ENGLAND BY ISS. REVISION DATE NOTES UNIT TITLE ΒY URIGIN WIRING CHANGES V SEL AND SW ADDED C21 ADDED BRI VALUE CHANGE CCT REDESIGN CCT REDESIGN AAT 29-02-96 AAT 01-04-96 AAT 30-04-96 CD 5-2-96 DWD 6-11-97 NB 18-11-97 ARJ 2-2-98 1. RESISTORS MARKED * ARE 1% ALL OTHERS ARE 5% 1/4W UNLESS OTHERWISE MARKED ALLEN & HEATH PSU_CIRCUIT_DIAGRAM | DRAWING NO. C2552 DRAWING TITLE 2. ELECTROLYTIC CAPACITORS ARE ?F/VOLTS

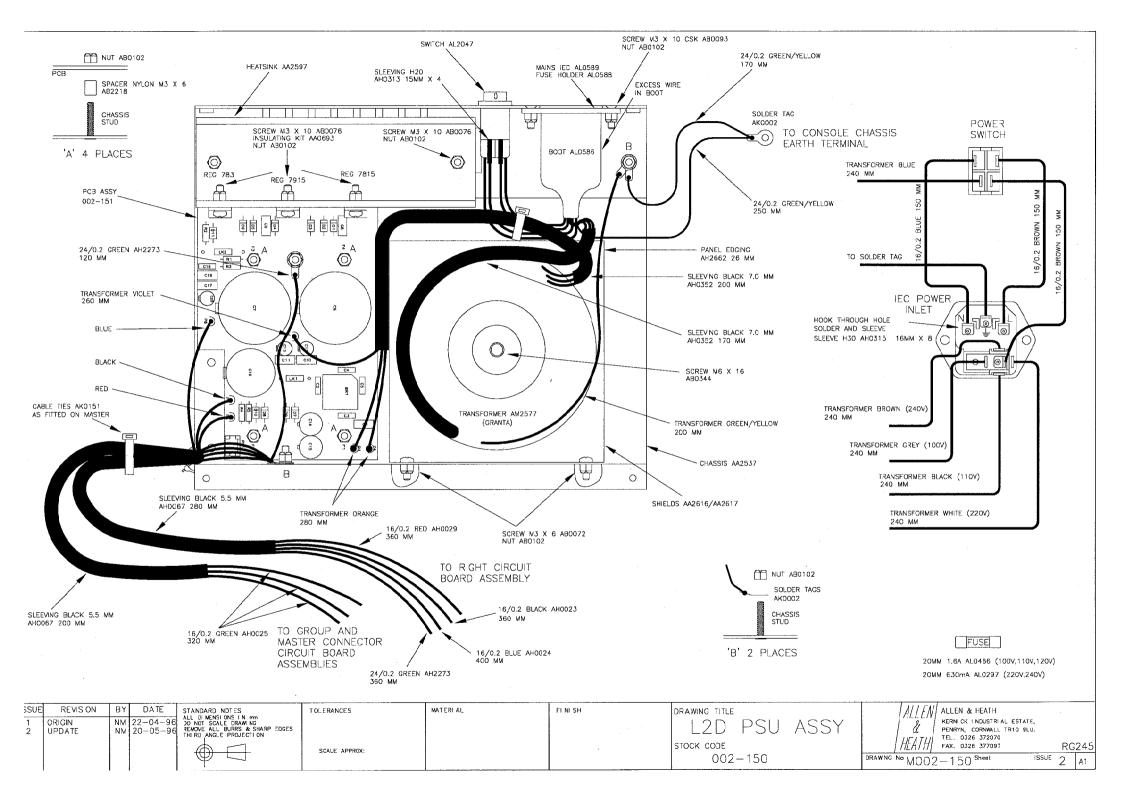

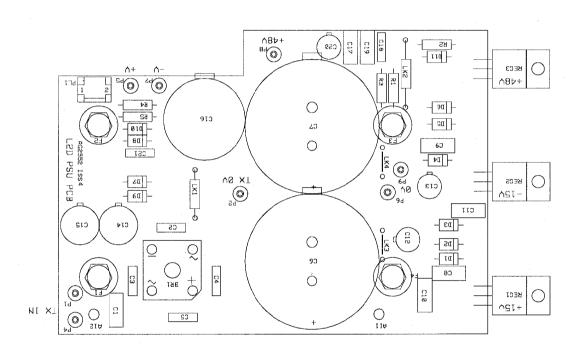

DANGER - HIGH YOLTAGE ! DISCONNECT POWER BEFORE REMOVING POWER SUPPLY UNIT

DISCONNECT POWER BEFORE REMOVING POWER SUPPLY UNIT REFER SERVICE WORK TO QUALIFIED SERVICE PERSONNEL ONLY

