


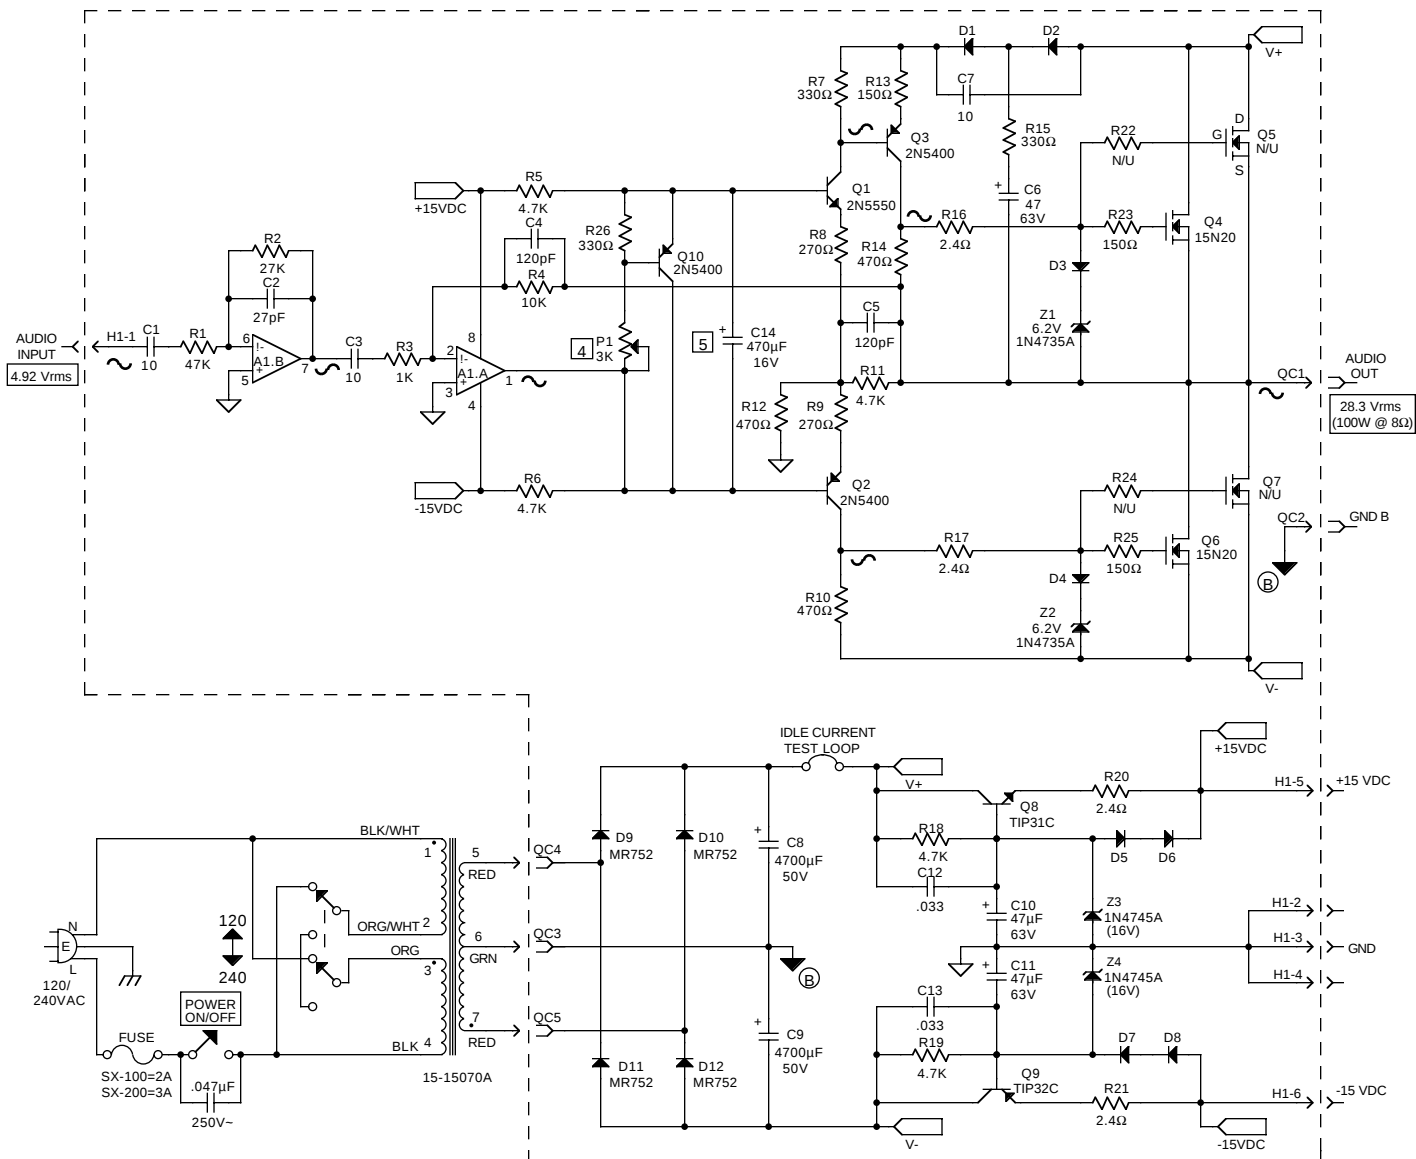

5. ADDED AS SECONDARY.

4. ADJUST P1 FOR 200mA AT IDLE CURRENT TEST LOOP.

3. A1 IS A 4558 TYPE OP AMP.

2. ALL CAPACITORS IN MICROFARADS (EXCEPT AS NOTED).

1. ALL DIODES ARE 1N4003 (EXCEPT AS NOTED).

NOTES: UNLESS OTHERWISE SPECIFIED.

LAST USED LIST			
SYM			
A	1		
C	14		
D	12		
H	1		
P	1		
Q	10		
R	26		
Z	4		

CARVIN		12340 World Trade Drive San Diego, CA 92128 (858) 487-1600 FAX 521-6032	
		FET100 POWER MODULE (USED IN SX-100, SX-200)	
DRAWN BY:		DATE:	
C. McEUN		10JAN91	
APPROVED:		DATE:	
PCB NO:		REV:	
30-FET100-8		A	
ASSY. NO:		REV:	
80-01018		C	
REVISED BY:		DATE:	
C. McEUN		14JAN91	