

3-7. American Assoc. of Bioanalysis, Cincinnati, Ohio. (L. D. Hertert, 490 Post St., Room 1049, San Francisco 2.)

3-7. American College of Chest Physicians, Atlantic City, N.J. (M. Kornfeld, 112 E. Chestnut St., Chicago, Ill.)

3-10. Quantitative Biology, symp., 24th, Cold Spring Harbor, N.Y. (M. Demerec, Director, Biological Lab., Cold Spring Harbor, N.Y.)

4. Fine Structure as Related to Absorption, Synthesis and Transport in the Gastrointestinal Tract, symp., Atlantic City, N.J. (E. C. Texter, Gastroenterology Research Group, Medical School, 303 E. Chicago Ave., Northwestern Univ., Chicago 11, Ill.)

4. Petroleum Geochemistry, symp., New York, N.Y. (E. G. Baker, Esso Research and Engineering Co., P.O. Box 51, Linden, N.J.)

4-5. American Geriatrics Soc., Atlantic City, N.J. (R. J. Kraemer, 2907 Post Rd., Warwick, R.I.)

4-6. Endocrine Soc., 41st annual, Atlantic City, N.J. (H. H. Turner, 1200 N. Walker, Oklahoma City, Okla.)

4-7. American Medical Womens Assoc., Atlantic City, N.J. (Miss L. T. Majally, 1790 Broadway, New York 19.)

4-7. American Therapeutic Soc., Atlantic City, N.J. (O. B. Hunter, Jr., 915 19 St., NW, Washington 6.)

4-9. Electrolytes, intern. symp., Trieste, Italy. (Societa Italiana per il Progresso delle Scienze 7, Rome, Italy.)

5-7. American College of Angiology, 5th annual, Atlantic City, N.J. (A. Halpern, 11 Hampton Court, Great Neck, N.Y.)

5-7. American Gastroenterological Assoc., and American Gastroscopic Soc., annual, Atlantic City, N.J. (H. M. Pollard, University Hospital, Ann Arbor, Mich.)

6. American Acad. of Tuberculosis Physicians, Atlantic City, N.J. (O. S. Levin, P.O. Box 7011, Denver 6, Colo.)

6. International Cardiovascular Soc. (North American Chapter), Atlantic City, N.J. (P. T. DeCamp, 3503 Prytania St., New Orleans, La.)

6-7. American Diabetes Assoc., Atlantic City, N.J. (E. Paul Sheridan, 1 E. 45 St., New York 17.)

6-7. Society of Investigative Dermatology, Inc., 20th annual, Atlantic City, N.J. (H. Beerman, 255 S. 17, Philadelphia 3.)

6, 20, and 27. Recent Advances in Medical Technology, symp., Staten Island, N.Y. (N. Colosi, Wagner College, Staten Island, N.Y.)

7-11. American Soc. of Heating and Air Conditioning Engineers, semi-annual, Vancouver, B.C., Canada. (A. V. Hutchinson, ASHACE, 62 Worth St., New York 13.)

7-13. Fertility and Sterility, 3rd world cong., Amsterdam, Holland. (W. W. Williams, 20 Magnolia Terrace, Springfield, Mass.)

8-12. American Medical Assoc., Atlantic City, N.J. (F. J. L. Blasingame, 535 N. Dearborn St., Chicago 10, Ill.)

8-12. Association for Research in Ophthalmology, Inc., Atlantic City, N.J. (L. V. Johnson, 10515 Carnegie Ave., Cleveland 6, Ohio.)

(See issue of 17 April for comprehensive list)

**READY MAY 1959**

*New text teaches anatomy with half the number of words and twice the number of illustrations!*

# Anatomy of the Human Body

by **R. D. LOCKHART, M.D., Ch.M., F.R.S.E., F.S.A. (Scot.)**, *Regius Professor of Anatomy, Aberdeen University*; **G. F. HAMILTON, M.B., Ch.B., F.S.A. (Scot.)**, *Senior Lecturer in Anatomy Aberdeen University*; and **F. W. FYFE, M.B., Ch.B.**, *Associate Professor of Anatomy, Dalhousie University, Halifax, Nova Scotia.*

This handsome new text was written with the express purpose of lightening the burden of the anatomy student and quickening his interest in the importance of the subject. It was written on the premise that a picture—even a small one—is worth many words.

## DISTINCT ADVANTAGES OF THIS TEXT

- Concise yet complete coverage without recourse to small print.
- Text avoids repetition, omits the obvious.

• Much of text carried in labelling of illustrations.

• Clinical aspects of functions are stressed in the text, not segregated to the end of each section.

• Nomenclature follows recommendations of International Congress of Anatomists at Paris, 1955.

• Where pronounced dissimilarities exist between new and older terms, both the new and the more familiar terms are given.

**697 Pages. 965 Figure Numbers, 600 in Color. NEW, 1959 \$13.50**

**EXAMINE THIS BOOK FREE FOR 10 DAYS WITHOUT OBLIGATION TO BUY**

Write to Dept. WRB

**J. B. LIPPINCOTT COMPANY**, Publishers  
East Washington Square Philadelphia 5, Pa.



**PROVIDING  
UNPRECEDENTED  
PERFORMANCE  
IN CRITICAL  
OPERATIONS**

ESTABLISHES NEW HIGH STANDARDS OF  
DEPENDABLE IMPERVIOUS PROTECTION

CHARCO'S "NEO-SOL" ALL-MILLED NEOPRENE

**DRY BOX  
GLOVE**

FLEXIBLE, FINGER-SENSITIVE AND COMFORTABLE  
SAFE AND TROUBLE-FREE PERFORMANCE

CHARCO Dry Box Gloves are manufactured of MILLED  
NEOPRENE by the Multiple-Dip Cement Method, using  
MOLECULAR solvent solutions of neoprene.

**HIGH VOLTAGE TESTED**

CHARCO'S electrical test is made after  
visual and other inspections. It insures  
that each glove is free from hazardous  
defects.

In Complete  
Range  
Of Styles

Write for **FREE ILLUSTRATED FOLDER**

**CHARLESTON RUBBER COMPANY**  
9 STARK IND. PARK CHARLESTON, SOUTH CAROLINA

## New Products

*The information reported here is obtained from manufacturers and from other sources considered to be reliable, and it reflects the claims of the manufacturer or other source. Neither Science nor the writer assumes responsibility for the accuracy of the information. A coupon for use in making inquiries concerning the items listed appears on page 1238.*

■ **RASTER TIMER** provides a sweep raster of ten traces on a d-c oscilloscope. Timers are available in two models with total sweep length from 10 to 100 msec and from 1 to 50 sec. Traces are marked with time calibrations. (American Electronic Laboratories, Inc., Dept. 775)

■ **MELTING-POINT APPARATUS** heats to 400°C in 6 min and cools from 400° to 300°C in 3 min. Capillaries are heated by a block of high thermal conductivity. Temperature is measured by a thermometer. Three capillaries are accommodated at one time. (Laboratory Devices, Dept. 783)

■ **FRACTION COLLECTOR** uses a stainless-steel belt to carry a continuous train of test tubes past a fixed filling point. The belt consists of separate detachable links which enable the user to arrange batches in any required number and in any combination. Individual tubes or groups of

tubes may be removed during a run without interrupting the process. The number of fractions which can be collected in a run varies with the size of test tubes used from 600 (for tubes up to 5 ml each) to 150 (for tubes up to 60 ml each). Fraction volume is controlled by photoelectric detection of liquid meniscus level. A drop counter is also available that will handle up to 9999 drops at rates up to 10 drops per second. (Baird & Tatlock, Dept. 784)

■ **STEREOCAMERA ADAPTER**, designed for use with the manufacturer's stereoscopic microscopes, permits the camera to swing into and out of position over the eyepieces. A prism compensating system renders the camera parfocal with the optical system of the microscope. (American Optical Co., Dept. 790)

■ **"INCHWORM" MOTOR** is a linear actuator that provides motion controllable in microinch increments. The motor utilizes a magnetostrictive armature that expands and contracts under the influence of a magnetic field. A pair of magnetic clamps, operating in conjunction with the armature, converts the contraction and expansion to motion in either direction. The operating cycle for a single-step motion is of about 1-sec duration.

The size of the step is a function of the magnetic field and hence of coil current and is adjustable from 0 to 0.000130 in. Loads up to 4 lb can be handled. (Airborne Instruments Laboratory, Inc., Dept. 796)

■ **AUTOCALVE** of rocking type is designed to impart shaking as well as rocking motion to the reactants. Rocking arc and speed are adjustable. A visual indicator enables the operator to see degree of agitation. One-liter or two-liter vessels are supplied. (Autoclave Engineers, Inc., Dept. 794)

■ **DUAL-CHANNEL RECORDER** is a null-balance, potentiometer-type recorder. Span is continuously variable from 10 to 100 mv. Chart width is 6 in. with 4.5 in. calibrated. Full-scale balance time is 0.8 sec. Accuracy is  $\pm 1$  percent and sensitivity is  $\pm 0.25$  percent of full scale. Various chart speeds are available. (San Jose Scientific Co., Dept. 795)

■ **DISSOLVED-HYDROGEN ANALYZER** for use with metals and other solid materials is a smaller, single-purpose counterpart of the general-purpose gas analyzer previously available. Hydrogen is separated from other gases by a filter made of palladium alloy. Hydrogen can be deter-



### A MICRO SYRINGE/BURETTE

Graduated In Units Of 0.0001 ml.

Volume of liquid delivered is precisely measured with a micrometer—down to 0.0001 ml.

Total capacity 0.25 ml.

Volume setting can be maintained for repeated deliveries of identical volumes.

Quickly converted from micro-syringe to micro-burette.

Teflon, glass, and stainless steel construction.

Write for Brochure SM

**CALIFORNIA LABORATORY EQUIPMENT CO.**  
98 Rincon Road • Berkeley 7, California

## ZOOGEOGRAPHY

**NEW**

**Editor CARL L. HUBBS**

**To the Memory of Charles Darwin  
and Alfred Russel Wallace**

**AAAS Symposium Volume No. 51**

**510 + x pp., 115 illus., 13 tables, 6 x 9, author index  
index of scientific names, references, cloth**

**AAAS members' cash orders \$10.50, Retail \$12.00**

**August 1957 Stanford Symposium:**

**The Origins and Affinities of the  
Land and Freshwater Fauna  
of Western North America**

**December 1957 Indianapolis Symposium:**

**Some Unsolved Problems in Biology, 1957:**

**Geographic Distribution of  
Contemporary Organisms**

... a vast storehouse of information,  
... a kinetic approach, concerned with processes and  
explanations  
... great diversity in: groups of organisms—areas covered  
—topics stressed—angle of approach


**English Agents: Bailey Bros. & Swinfen, Ltd.,  
Hyde House, West Central Street, London W.C.1**

**American Association for the Advancement  
of Science**

**1515 Massachusetts Avenue, NW, Washington 5, D.C.**

# GLASS ABSORPTION CELLS

made by **KLETT**

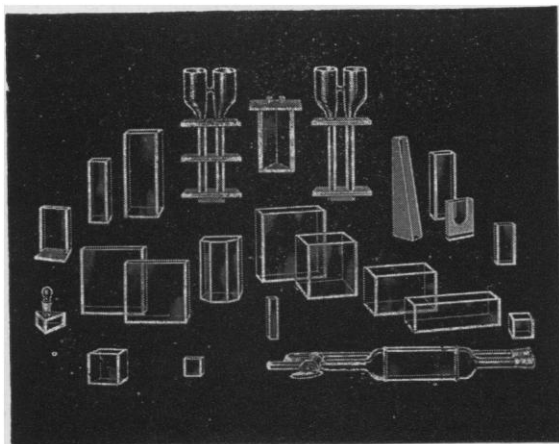


## SCIENTIFIC APPARATUS

Klett-Summerson Photoelectric Colorimeters—  
Colorimeters—Nephelometers—Fluorimeters—  
Bio-Colorimeters—Comparators—Glass Stand-  
ards—Klett Reagents.

**Klett Manufacturing Co.**  
179 East 87 Street, New York, New York

# PHOTOVOLT Line-Operated Multiplier FLUORESCENCE METER Mod. 540

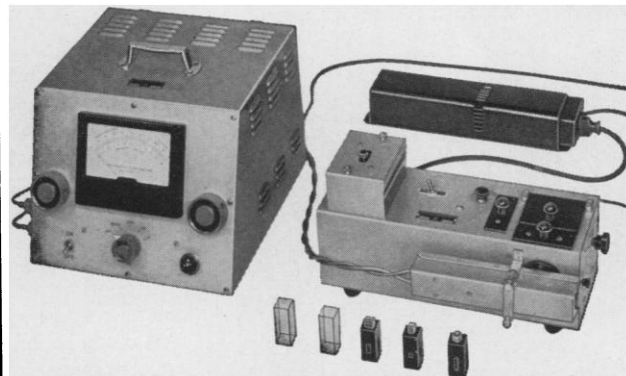

- High-sensitivity for measurement of low concentrations (full-scale setting for 0.001 microgram quinine sulphate)
- Micro-fluorimetry with liquid volumes as low as 1 ml
- Low blank readings, strict linearity of instrument response
- Universally applicable due to great variety of available filters, sample holders, adapters and other accessories
- Interference filters for high specificity of results and for determining spectral distribution of the fluorescent light
- High-sensitivity nephelometry for low degrees of turbidities
- Fluorescence evaluation of powders, pastes, slurries, and solids, also for spot-tests on filter paper without elution

Write for Bulletin #392 to

## PHOTOVOLT CORP.

95 Madison Ave.

New York 16, N.Y.


# Welch **DENSICHRON**

## ELECTRONIC DENSITOMETER

ASSURES EXCEPTIONALLY STABLE READINGS OF  
TRANSMISSION AND REFLECTION DENSITIES

Makes Precision Light Measurements—Quickly—Accurately

*Good Sensitivity—High Stability*

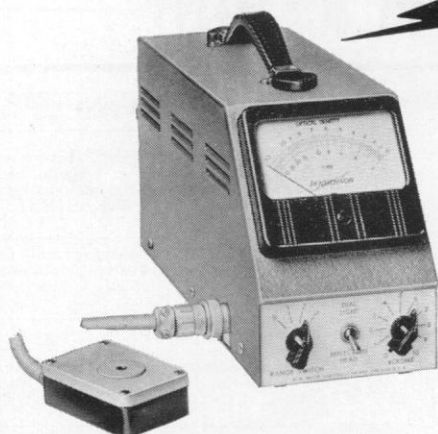

NO. 3830A DENSICHRON AND PROBE



NO. 3832A REFLECTION UNIT


## — SPECIAL FEATURES —

Patented Magnetic Modulation Convenient Small Size—5" x 7 1/4" x 13"  
Light in Weight—only 11 1/2 pounds Simple to Use

No. 3830A. Densichron with Blue or Red Probe, whichever is desired, including amplifier with logarithmic-scale meter, metal probe support, five different measuring apertures, a cone with 1/8 inch aperture and a set of instructions. The amplifier operates on 115 volts, 60 cycle A.C. only except on special order \_\_\_\_\_ Each \$250.00

No. 3832A. Reflection Unit. When coupled to the Densichron amplifier this unit becomes a convenient reflectance meter. It has a self-contained light source, filter wheel and phototube, and includes optics for both small and large spot work, a calibrated gray scale, and three Carrara working standards \_\_\_\_\_ Each \$160.00

Write for our new DENSICHRON catalog giving complete description on these and many other set ups and accessories.

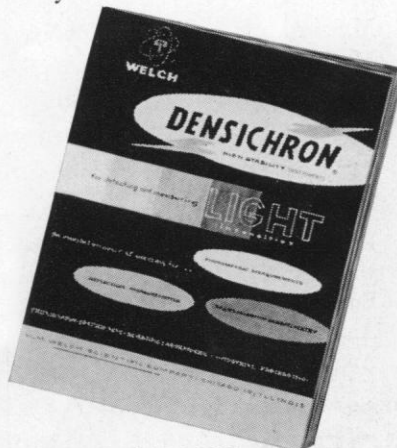

**W. M. WELCH SCIENTIFIC COMPANY**

DIVISION OF W. M. WELCH MANUFACTURING COMPANY


ESTABLISHED 1880

1515 Sedgwick Street, Dept. E

Chicago 10, Illinois, U. S. A.

Manufacturers of Scientific Instruments and Laboratory Apparatus

work in the fields of the future at NAA

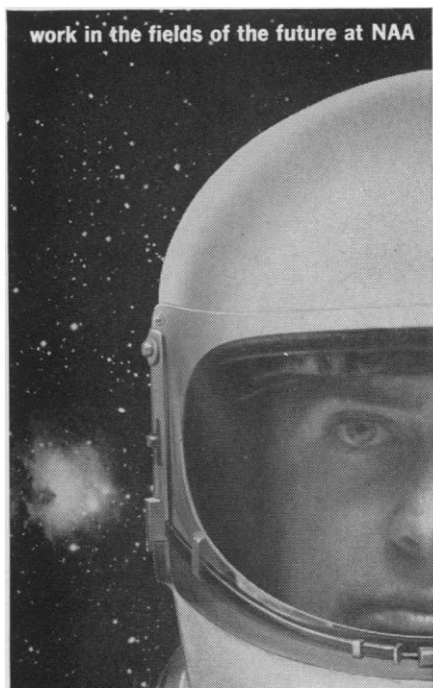

## OPERATIONS ANALYSIS

Opportunities for operations research analysis covering the spectrum of weapon systems. Application of analytical techniques to determination of weapon systems performance and effectiveness involving tactical analysis, statistics, game theory, and nuclear physics.

Facilities for research include new IBM 709, analog computer laboratory, and tactical game room.

M.S. or Ph.D. in Engineering, Math or Physics preferred. B.S. or B.A. with exceptional experience or recent graduates desiring this field are also encouraged to apply.

For more information please write to: Mr. C. R. Stevenson, Engineering Personnel, North American Aviation, Inc., Los Angeles 45, California.

THE LOS ANGELES DIVISION OF

**NORTH  
AMERICAN  
AVIATION, INC.**



mined in a 1-g sample over a range of 0.2 to 1000 parts per million. A precision of  $\pm 0.2$  ppm is claimed. Operation rate is given as four to five steel samples per hour. (Fisher Scientific Co., Dept. 808)

■ **SIGNAL GENERATOR** provides pulse-modulated radio-frequency signals over the range 2700 to 3000 Mc/sec. Output is continuously adjustable up to 10 w peak. Accuracy is  $\pm 0.25$  percent; re-settability,  $\pm 0.03$  percent; stability  $\pm 0.03$  percent. (B. J. Electronics, Dept. 785)

■ **ELECTRIC MORTAR GRINDER** is available with mortar and pestle of porcelain, steel, agate, or sintered corundum. The mortar can be detached or engaged without clamping or adjustment. The pestle head assembly can be tilted away for free access to the mortar. (Torsion Balance Co., Dept. 791)

■ **INFRARED ACCESSORIES** for ultramicro-analysis include an ultramicro sampling system, a reference-beam attenuator, and an ultramicro die. The sampling system uses reflecting optics to condense the sample beam six times, thus permitting full-scale spectra to be obtained with samples weighing as little as 1 to 2  $\mu$ g. The beam attenuator provides continuously variable attenuation over a range of 0 to 40 percent. The die, of stainless steel, presses KBr pellets of diameter 0.5 or 1.5 mm. (Perkin-Elmer Corp., Dept. 810)

■ **MICROVOLT METER** for d-c measurements is transistorized and chopper stabilized. Input impedance is 100 megohm on all ranges from  $\pm 0.001$  to  $\pm 1000$  v. An integral storage battery provides 12 hr of continuous operation. Recharge is automatic when the instrument is plugged into the power line. (Dynamics Instrumentation Co., Dept. 786)

■ **OSCILLATOR** features drift rate less than  $10^{-8}$ /day at 1 Mc/sec. A trimmer control for making frequency adjustments against crystal aging may be related to the instrument's known drift rate to extend the time interval between calibrations. Range of adjustment is 6 cy/sec. (Manson Laboratories, Inc., Dept. 792)

■ **LINEAL MEASURING SYSTEM** is designed for measurement of lineal feet of ferrous strip material passing a fixed point. The system operates by impressing magnetized areas at fixed intervals on the material and counting the number of pulses. Accuracy of 0.1 percent is claimed. (Designers for Industry, Dept. 797)

■ **MATCHED WEIGHING PAPERS** for use on analytical balances are circles of polyethylene-coated paper 3.125-in. in diameter. The reverse side can be marked with pen or pencil. Price is less than  $\frac{1}{2}$  ct each. (Nutheme Co., Dept. 787)

JOSHUA STERN

National Bureau of Standards,  
Washington, D.C.

## PERSONNEL PLACEMENT

**CLASSIFIED: Positions Wanted, 25¢ per word, minimum charge \$4. Use of box number counts as 10 additional words. Payment in advance is required. Positions Open, \$33 per inch or fraction thereof. No charge for box number.**

**COPY** for classified ads must reach SCIENCE 2 weeks before date of issue (Friday of every week).

**DISPLAY:** Rates listed below—no charge for box number. Monthly invoices will be sent on a charge account basis—provided that satisfactory credit is established.

Single insertion	\$33.00 per inch
4 times in 1 year	30.00 per inch
7 times in 1 year	28.00 per inch
13 times in 1 year	27.00 per inch
26 times in 1 year	26.00 per inch
52 times in 1 year	25.00 per inch

**For PROOFS** on display ads, copy must reach SCIENCE 4 weeks before date of issue (Friday of every week).

**Replies to blind ads** should be addressed as follows:  
Box (give number)  
Science  
1515 Massachusetts Ave., NW  
Washington 5, D.C.

### POSITIONS WANTED

Biological Oceanographer, receiving Ph.D. this summer, desires teaching-research position, September 1959. Background: oceanography, marine microbiology, invertebrate zoology, ecology. Box 100, SCIENCE. 5/8

### POSITIONS WANTED

Medical Microbiologist, male, M.S. Interested in relocating, challenging position hospital bacteriological department. Available late summer, early fall. Prefer Florida. Box 102, SCIENCE. X

Microbiologist, Ph.D., with teaching and research experience, including tissue culture, wants research position in cell biology. Box 91, SCIENCE. 5/1

Physics Teacher, M.S., 5 years. Summer position leading to permanent teaching post in rural college beginning September 1960. Maximum load; two courses or 12 contact hours. Box 101, SCIENCE. X

### POSITIONS OPEN

Biochemist. Ph.D. in biochemistry or physical chemistry; to participate in characterization of cardiac contractile proteins, actin and myosin, by modern physical-chemical methodology including ultracentrifugation, light scattering and diffusion measurements; effect of steroids including digitalis glycosides upon protein structure. Salary: \$6000-\$7000. Please reply to Dr. Robert E. Olson, Professor and Head, Department of Biochemistry and Nutrition, Graduate School of Public Health, University of Pittsburgh, Pittsburgh 13, Pennsylvania. 5/8

Botanist-Bacteriologist. Ph.D. or equivalent, to teach bacteriology and some botany. Rank of assistant professor. Write Professor W. B. Stallworthy, Department of Biology, Mount Allison University, Sackville, New Brunswick, Canada. ew tf

# *An Invitation to Systems Specialists from*



Systems Engineers and Scientists are afforded a unique opportunity to join, during its formative stages, this non-profit organization created to provide system engineering support to the Air Defense Systems Integration Division (ADSID) of the United States Air Force.

Men with outstanding capabilities in the problems associated with large-scale subsystems such as:

COMMUNICATIONS SYSTEMS

DETECTION SYSTEMS

DATA PROCESSING SYSTEMS

WEAPONS SYSTEMS

are invited to make confidential inquiry.

---

*Please contact Director of Personnel*

THE MITRE CORPORATION


244 Wood Street • Lexington 73, Massachusetts




GUEST-WEICHSSELBAUM and STRUMIA

# CAPILLARY TUBES

- For the clinical estimation  
of blood cell volume  
by centrifuge methods

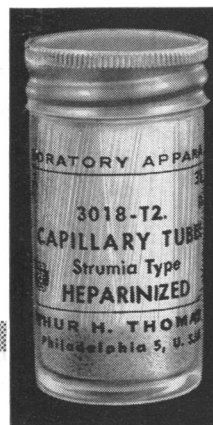

3018-T2.

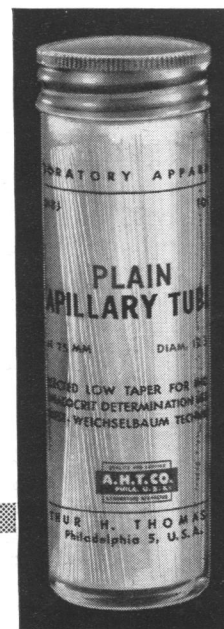

3018-J.

**CAPILLARY TUBES, Heparinized**, of soda-lime glass, for determining blood cell volume by Guest-Weichselbaum technique. With thin wall and open ends; specially selected for freedom from taper and curvature. Length 75 mm, outside diameter 1.2 to 1.4 mm. Packed in nickel plated screw cap, plastic vials with polyurethane pad in top and bottom.

**3018-H. Capillary Tubes, Heparinized**, as above described.

Per ½ oz. vial of approximately 100..... 1.15

**3018-J. Ditto**, but without heparin coating.

Per ½ oz. vial of approximately 100..... .80

10% discount in carton containing 12 vials

15% discount in lots of 72 vials { 3018-H and 3018-J,

20% discount in lots of 144 or more { one number or assorted

**CAPILLARY TUBES, Strumia Type, Oxalated**, of soda-lime glass, carefully selected for uniform inside diameter, for use in 3018-P Centrifuge. Size 32 mm long × 0.8 mm outside diameter, with open ends and uniform wall 0.1 mm thick. Prepared to precise tolerances and coated with anticoagulant mixture of ammonium and potassium oxalate in accordance with Strumia technique. Packed in transparent plastic, screw cap vials containing 500.

**3018-T. Capillary Tubes, Strumia Type, Oxalated**, as above described.

Per vial of 500..... 6.25

**3018-T2. Ditto**, but with heparin (ammonium heparinate) coating, which is preferred by some technicians. Per vial of 500.....

7.25

**3018-T5. Ditto**, but without oxalate or heparin coating. Per vial of 500... 4.50

10% discount in lots of 12 vials { 3018-T, 3018-T2 and 3018-T5,

15% discount in lots of 24 vials { one number or assorted



## ARTHUR H. THOMAS COMPANY

More and more laboratories rely on Thomas / Laboratory Apparatus and Reagents

VINE ST. AT 3RD • PHILADELPHIA 5, PA.