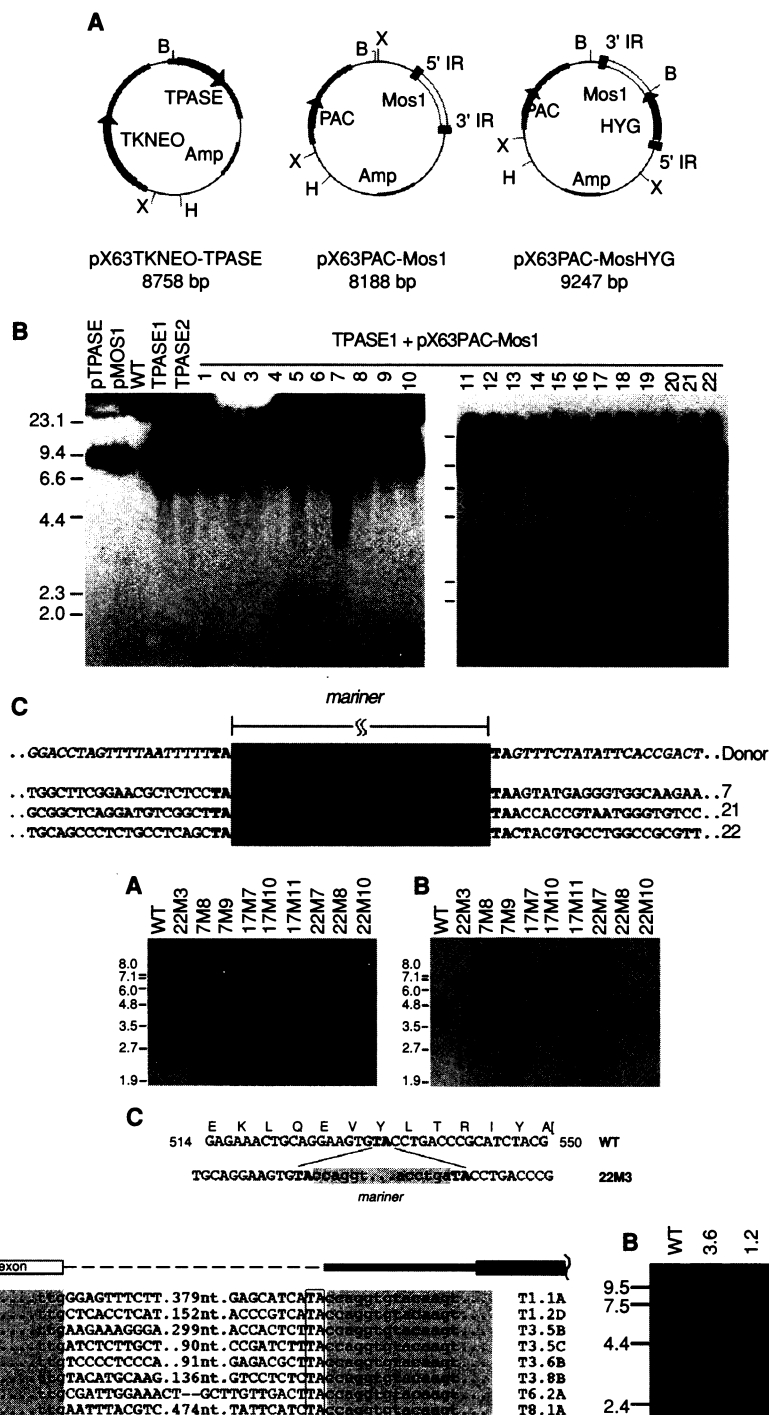


Corrections and Clarifications

In Philip H. Abelson's editorial "Proposed air pollutant standards" (4 July, p. 15), reference in the fourth paragraph to "particulate matter with diameters of 10 millimeters" was incorrect. The correct diameter should have been "10 micrometers."

The name of G.-J. Bartstra was misspelled in reference 5 of the Technical Comment "Dating the Ngandong humans" by R. Grün and A. Thorne (6 June, p. 1575).

In the report "Trans-kingdom transposition of the *Drosophila* element *mariner* within the protozoan *Leishmania*" by F. J. Gueiros-Filho and S. M. Beverley (13 June, p. 1716), all of the figures were printed too lightly, and crucial information could not be seen. The correct figures can be seen on the World Wide Web at www.sciencemag.org and are printed below. From top, figure 1, A through C; figure 2, A through C; and figure 3, A and B.

TIME
MACHINE

THE NEW

MINI-PREP 24

FOR AUTOMATED
PLASMID MINI-PREPS

- **Fast**—up to 24 preps per hr, saving you valuable time.
- **High Purity**—sufficient for automated fluorescent and manual sequencing.
- **Easy Operation**—begin prep with direct loading of bacterial culture. No centrifugation step saves you time.
- **Consistent Results**—up to 6 μ g of plasmid per ml. Quality DNA ... time and time again.

Call now to learn how the
New Improved Mini-Prep 24 can give
you quality DNA and save time by
automating your plasmid DNA preps!

1-800-466-7949

MacConnell
RESEARCH

11339 Sorrento Valley Road

San Diego, CA 92121

(619) 452-2603 • Fax (619) 452-6753

www.macconnell.com

Circle No. 22 on Readers' Service Card